

Fire Pump Controller

For Electric Motor Driven Fire Pumps



Metron
Eledyne



Across The Line Type

Series MP300 - Combined Manual and Automatic

Metron Fire Pump Controllers conform to the latest requirements of Chapter 7, National Fire Protection Association Pamphlet 20, Standard for Centrifugal Fire Pumps as adopted by Underwriters Laboratories and Factory Mutual. They are withstand rated and listed by Underwriters' Laboratories and approved by Factory Mutual Research Corporation.

Sizes range from 15 to 600 horsepower, 200 to 600 volts, 60 Hz. These controllers are for use on Across-the-Line type installations.

Only the highest quality components, all UL listed or UL recognized, are used throughout to assure the best possible reliability. The cabinet is fabricated of heavy gauge reinforced steel with drip-proof hood. All field wiring and service connections may be made from the front, allowing the controller to be mounted flush against a wall.

The controller is completely wired, assembled, and tested at the factory before shipment, and ready for immediate installation.


MP300 Fire Pump Controller



Standard and Optional Features

Standard Features

Operator Interface Device (OID) with LED Annunciator and Digital Display

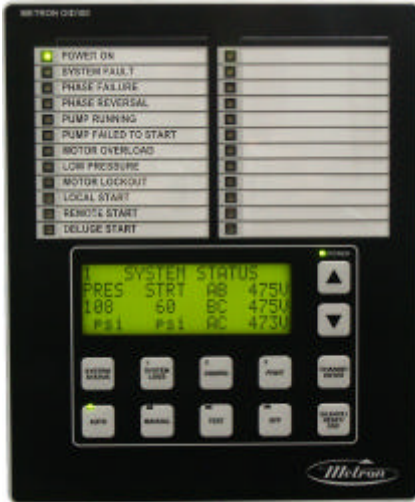

- NEMA Type 2 drip proof metal freestanding enclosure
- AUTO, MANUAL, TEST, and OFF mode buttons illuminated with colored LED's for controller mode operation
- Operator Interface Device (OID) with 4 lines by 20 character display with large character backlit Liquid Crystal Display (LCD) capable of being read in both direct sunlight or dark lighting conditions
- 12 pushbuttons for easy screen navigation, system mode changes, alarm reset, and horn silencing
- Multicolored LED's for alarm and mode annunciation
- Removable labels to allow for easy field modification of additional alarms and/or language changes
- All controller settings are programmable through the OID. All features are enabled or disabled through the OID, no jumpers or external wires are needed allowing easy field modification
- The system status data shall be displayed on the OID. The displayed items include: System pressure, Phase to Phase (AB, BC, AC) voltage, Phase current (A, B, C), Current time and date, Number of starts, Total motor run hours, Time remaining on sequential motor start and motor stop timers.
- Audible horn with silence feature for silencable alarms
- Lamp test feature
- English or Spanish languages selectable through the OID
- Microprocessor based logic with real time/date clock capable of running a minimum of 14 days without AC power connected to controller
- Non-volatile flash memory, that does not require the use of a battery or external power. The flash memory permanently

stores the continuous pressure log, event log, alarm log and all user changeable set points and system data.

- Input and output status LED's provide visual indication of each discrete input's or output's on/off status
- One RS232 Serial Port
- One USB 1.0 Port
- One RS485 Serial Port

Auxiliary alarms:

The controller includes as standard six (6) discrete auxiliary inputs, Nine (9) form 'C' auxiliary relay outputs. These auxiliary inputs and outputs are in addition to those mandated by NFPA 20. All auxiliary inputs, outputs, and OID LED's can be field programmed through the OID.

Nine (9) of the following auxiliary alarms can be programmed and recorded in the event/alarm logs and annunciated with an LED and output relay contact for conditions such as:

- LOW PUMP ROOM TEMP
- RESERVOIR LOW
- RESERVOIR EMPTY
- RESERVOIR HIGH
- FLOW METER ON
- RELIEF VALVE OPEN
- LOW SUCTION PRESSURE
- HIGH PUMP ROOM TEMPERATURE
- LOW FIREWATER PRESSURE
- LOW PURGE PRESSURE
- LOW GEAR OIL PRESSURE
- HIGH GEAR OIL TEMPERATURE
- GAS DETECTION
- HIGH VIBRATION
- EMERGENCY POWER ON
- PUMP ROOM DOOR OPEN

Data logging:

The controller includes three (3) separate data logs for storing system data that is readable through the OID or printed on the optional internal printer. The 3 data logs are as follows:

Pressure Log: The pressure log provides a continuous pressure record for a minimum of 7 days but it is capable of storing more than 30 days of data depending on the sample rate set by the customer. The pressure log samples shall be time and date stamped and stored in permanent non-volatile flash memory. The pressure log can be searched by each sample, by minute, or by hour.

Event Log: The event log will store more than 4000 events. These events can include, but is not limited to, any of the following events/alarms:

- PUMP RUNNING
- POWER AVAILABLE
- PHASE REVERSAL
- MOTOR OVERLOAD
- REMOTE START

LOCAL START
 PUMP ON DEMAND
 SYSTEM FAULT
 AUTO MODE
 MANUAL MODE
 OFF MODE
 PRESSURE TRANSDUCER FAULT
 PUMP FAILED TO START
 LOW INTAKE SHUTDOWN ALARM
 SUPERVISORY POWER FAILURE
 LOW PRESSURE
 AUTO WEEKLY TEST START
 UNDER FREQUENCY
 OVER FREQUENCY
 LOW ZONE / HIGH ZONE CONTACTS
 HIGH DISCHARGE PRESSURE
 NO LOAD CONDITION

Alarm Log: The Alarm Log is a separate subset of the event log which displays the last 10 alarms recorded in the system.

Each event or alarm recorded in the either event log or alarm logs has the following data recorded with the event/alarm providing an accurate record of events:

- Time and Date of Event or Alarm
- System Pressure
- Descriptive Text Message of the Event/Alarm
- Motor Running Status
- Phase to Phase Volts
- Phase Amps

Options

Option H: Space Heater

If the ambient atmosphere is especially damp, a space heater rated at 100 watts may be supplied to reduce moisture in the cabinet. A thermostat is supplied as standard with this option. A humidistat may be substituted if specified.

Option T: Weekly Test Start Solenoid

In some cases it may be desirable to have the electric motor run at a preset time each week for approximately 30 minutes. The controller includes a built in weekly test function. This option complements the standard function by simulating a loss of pressure. Simulation of pressure loss is accomplished by opening a solenoid valve, which reduces the system pressure below the starting pressure of the controller.

Option W: Omit Legs


For systems where the controller is mounted on a common skid with the pump and motor, the legs of the controller may be omitted, and 3" mounting channels or wall mounting brackets can be supplied. If specified, lifting eyes may also be supplied.

Option Y: Printer

Dot matrix printer for selective printing of pressure log, event log, and alarm log data as well as system configuration set point settings.

Enclosure

The following NEMA type enclosures are also available: 3R, 4, 4X (Painted Cold Rolled Steel), 4X (Unpainted 304 or 316 Stainless Steel), and 12

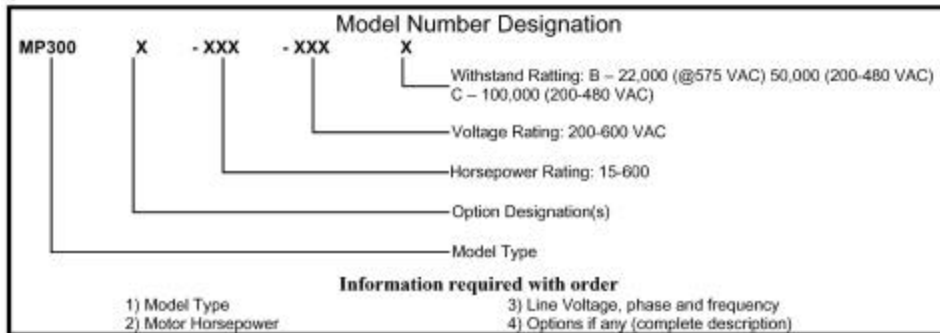

Standard Withstand Ratings: Model MP300

200-208 Volts	15-150 HP	100kA RMS Symmetrical
220-240 Volts	15-200 HP	100kA RMS Symmetrical
380-415 Volts	15-300 HP	100kA RMS Symmetrical
460-480 Volts	15-400 HP	100kA RMS Symmetrical
200-208 Volts	200-250 HP	50kA RMS Symmetrical
220-240 Volts	250-300 HP	50kA RMS Symmetrical
380-415 Volts	350-350 HP	50kA RMS Symmetrical
460-480 Volts	500-600 HP	50kA RMS Symmetrical
550-600 Volts	15-400 HP	22kA RMS Symmetrical

Fire Pump Controller

For Electric Motor Driven Fire Pumps

Model MP300 Across-the-line Start Microprocessor Electric Motor Fire Pump Controller

Specifications

General Controller Description

The Fire Pump Controller shall be factory assembled, wired and tested as a unit and shall conform to all requirements of the latest edition of NFPA 20, NFPA 70 and be Third Party Listed by Underwriters Laboratories (UL) and Approved by Factory Mutual (FM). The controller shall be available for 208, 230, 380-415, or 480 volt three phase power.

Controller Equipment Features

The controller shall include the following standard features:

- NEMA Type 2 drip proof metal freestanding enclosure
- AUTO, MANUAL, TEST, and OFF mode buttons illuminated with colored LED's for controller mode operation
- Operator Interface Device (OID) with 4 lines by 20 character display with large character backlit LCD capable of being read in both direct sunlight or dark lighting conditions
- 12 pushbuttons for easy screen navigation, system mode changes, alarm reset, and horn silencing
- Multicolored LED's for alarm and mode annunciation
- LEDs shall be labeled with removable labels to allow for easy field modification if additional alarms and/or language changes
- All controller settings shall be programmable through the OID and shall be protected by two password levels
- All features shall be enabled or disabled through the OID, no jumpers or external wires shall be needed or allowed to activate or de-activate a feature
- The system status data shall be displayed on the OID. The displayed items shall include: System pressure, Phase to Phase (AB, BC, AC) voltage, Phase current (A, B, C), Current time and date, Number of starts, Total motor run hours, Displayed countdown timers for: Sequential motor start and motor stop.
- Audible horn with silence feature for silencing alarms
- Lamp test feature

- English or Spanish languages selectable through the OID
- Microprocessor based logic with real time/date clock capable of running a minimum of 14 days without AC power connected to controller and non-volatile flash memory to permanently store the continuous pressure log, event log, alarm log and all user changeable set points and system data. Battery backup of any kind not allowed.
- Input and output status LED's to provide visual indication of each discrete input's or output's on/off status
- One RS232 Serial Port
- One USB 1.0 Port
- One RS485 Serial Port
- All wiring terminals on PCB's shall be removable type

Auxiliary alarms:

As standard the controller shall include 6 discrete auxiliary inputs, 9 form 'C' auxiliary relay outputs. These auxiliary inputs and outputs are in addition to those mandated by NFPA 20. All auxiliary inputs, outputs, and OID LED's shall be field programmable through the OID. This permits a multitude of customizable controller configurations to meet each installations unique needs without adding cost to the controller. The use of jumpers, soldering, or other external components are not allowed.

The user can select any 9 of the following auxiliary alarms that can be programmed and recorded in the event/alarm logs and annunciated with an LED and output relay contact for conditions such as:

LOW PUMP ROOM TEMP
RESERVOIR LOW
RESERVOIR EMPTY
RESERVOIR HIGH
FLOW METER ON
RELIEF VALVE OPEN
LOW SUCTION PRESSURE
HIGH PUMP ROOM TEMPERATURE
LOW FIREWATER PRESSURE
LOW PURGE PRESSURE
LOW GEAR OIL PRESSURE
HIGH GEAR OIL TEMPERATURE
GAS DETECTION
HIGH VIBRATION
EMERGENCY POWER ON
PUMP ROOM DOOR OPEN

Data logging:

The controller shall have three separate data logs for storing system data that is readable through the OID or

printable on the internal printer. These logs shall be as follows:

Pressure Log: The controller shall have a Pressure log with continuous pressure recording of minimum of 7 days and be capable of storing more than 30 days of data. The pressure log samples shall be time and date stamped and stored in permanent non-volatile flash memory. The pressure log shall be searchable by each sample, by minute, or by hour.

Event Log: The event log shall be capable of storing no less than 4000 events. These events shall include, but is not limited to, any of the following events/alarms:

PUMP RUNNING
POWER AVAILABLE
PHASE REVERSAL
MOTOR OVERLOAD
REMOTE START
LOCAL START
PUMP ON DEMAND
SYSTEM FAULT
AUTO MODE
MANUAL MODE
OFF MODE
PRESSURE TRANSDUCER FAULT
PUMP FAILED TO START
LOW INTAKE SHUTDOWN ALARM
SUPERVISORY POWER FAILURE
LOW PRESSURE
AUTO WEEKLY TEST START
UNDER FREQUENCY
OVER FREQUENCY
LOW ZONE / HIGH ZONE CONTACTS
HIGH DISCHARGE PRESSURE
NO LOAD CONDITION

Alarm Log: The Alarm Log shall be a separate subset of the event log and shall display the last 10 alarms recorded in the system.

Each event or alarm recorded in the either event log or alarm logs shall have the following data recorded with the event/alarm:

- Time and Date of Event or Alarm
- System Pressure
- Descriptive Text Message of the Event/Alarm
- Motor Running Status
- Phase to Phase Volts
- Phase Amps

The internal logic of the controller shall be capable of operation in a temperature range of 0°C to 50°C and high, non-condensing, humidity levels.

The controller shall be manufactured by Metron.

METRON ELEDYNE LIMITED

18 Autumn Park, Dysart Road, Grantham, LINCS. NG31 7DD. United Kingdom
Telephone: +44 (0) 1476 516120 FAX: +44 (0) 1476 516121 email: info@metroneledyne.co.uk
www.metroneledyne.co.uk